



LOUISIANA DEPARTMENT OF PUBLIC SAFETY & CORRECTIONS
PUBLIC SAFETY SERVICES




H. "BUTCH" BROWNING, JR.
STATE FIRE MARSHAL

OFFICE OF STATE FIRE MARSHAL

- 5 tablespoons (1/3rd cup) bleach per gallon of water, or
- 4 teaspoons bleach per quart of water.
- Alcohol solutions with at least 70% alcohol may also be used.

Sample Seating Layout

Normal maximum capacity = 360, Phase 1 maximum capacity = 90 (25%)

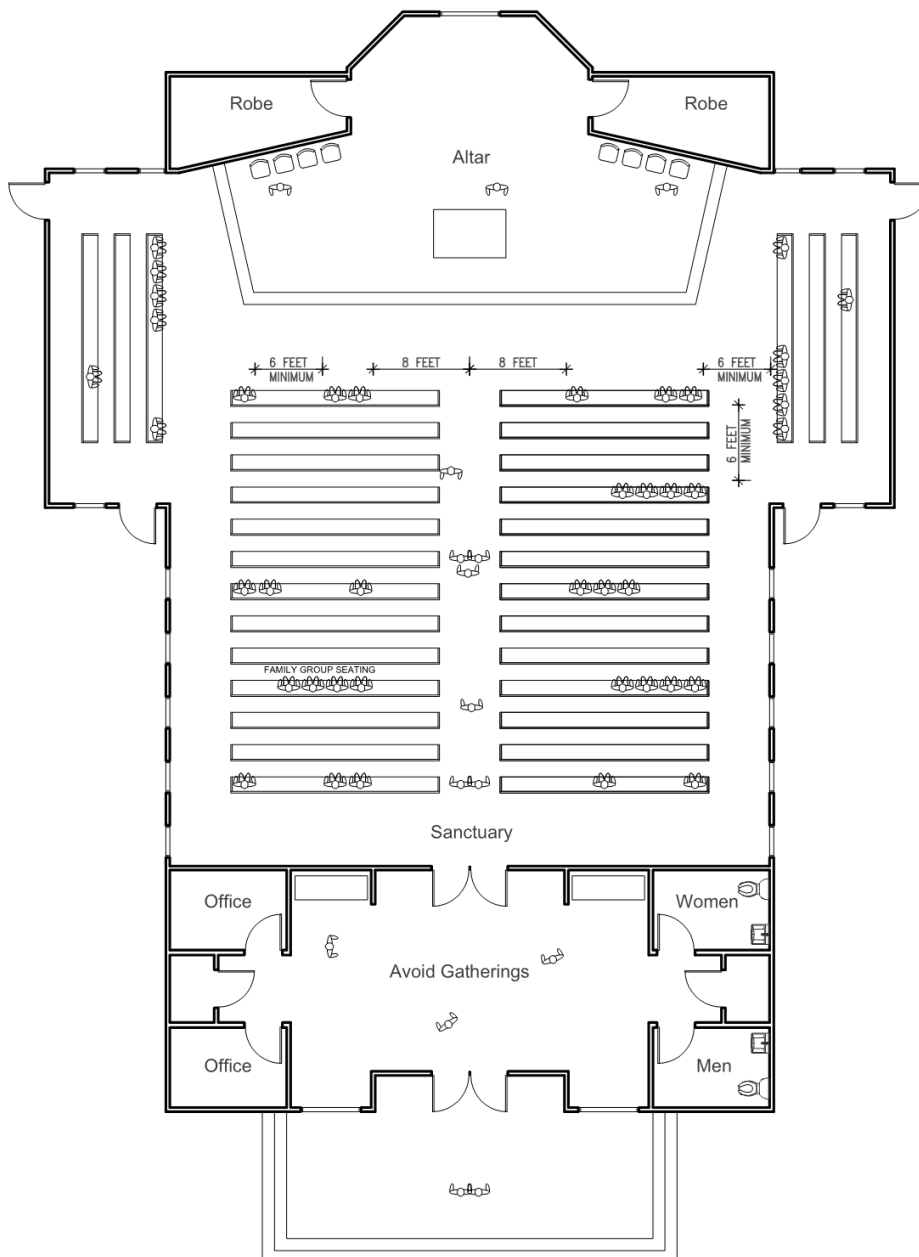

8181 Independence Blvd. ♦ Baton Rouge, LA 70806 ♦ 1.800.256.5452 ♦ 225.925.4911 ♦ www.lasfm.org